



# Certificate of Conformity

Global-Mark Pty. Ltd., certify the electrical equipment described hereunder complies with standards listed herein and notifies the certificate holder to affix the authorised Approval Mark on the product of the same type and the Regulatory Compliance Mark (RCM) mark provided that the requirements of all relevant parts of AS/NZS 4417 applicable to the article are fulfilled. In placing the Approval and RCM mark on the product, the Responsible Supplier makes a declaration of compliance with the certification standard(s) and confirms that the product is identical to the product certified herein. – This Certificate meets the requirements of a Recognised External Certification Scheme (EESS- RECS) and a Recognised External Approval Scheme (NSW-REAS).

## CERTIFICATION AND CERTIFICATE HOLDER DETAILS

Company Name	<b>Schneider Electric (Australia) Pty Ltd</b>	Other Name	
Address	<b>33-37 Port Wakefield Road Gepps Cross SA 5094 Australia</b>		
Client ID	<b>102093</b>	Global-Mark File Number:	<b>102093-340</b>
Certificate Number & Approval Mark	<b>GMA-514316-EA</b>	Revision Number	<b>01</b>
Certification Standard(s)	<b>AS/NZS 61009.1:2015 Residual current operated circuit-breakers with integral overcurrent protection for household and similar uses (RCBOs) - General rules</b>		
Type of Certification	<b>Electrical Safety Product</b>	Scheme	<b>Global-Mark Electrical Product Safety Certification Scheme</b>

System 1 Approval

## CERTIFICATE DATES

Certificate Issue Date	<b>15/12/2022</b>
Certificate Last Update Date	<b>12/11/2023</b>
Certification Expiry Date	<b>15/12/2027</b>

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate of Conformity remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to [www.jasanz.org/register](http://www.jasanz.org/register) for verification.



Certification Manager

Page 1 of 3

Global-Mark Pty Ltd, Copyright 2012 - 407, 32 Delhi Road, North Ryde NSW 2113, Australia



# Certificate of Conformity

CERTIFIED ELECTRICAL EQUIPMENT				
Declared Article	Product Description	Trade Name	Model Number	Rating
Residual Current Device	RCBO	Schneider Electric	A9DD1916	400/415Vac, 50Hz, 16A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1963	400/415Vac, 50Hz, 63A, 30mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DD1910	400/415Vac, 50Hz, 10A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DD1932	400/415Vac, 50Hz, 32A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DD1920	400/415Vac, 50Hz, 20A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DD1925	400/415Vac, 50Hz, 25A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1925	400/415Vac, 50Hz, 25A, 30mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1916	400/415Vac, 50Hz, 16A, 30mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1920	400/415Vac, 50Hz, 20A, 30mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1950	400/415Vac, 50Hz, 50A, 30mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1932	400/415Vac, 50Hz, 32A, 30mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1940	400/415Vac, 50Hz, 40A, 30mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC0920	400/415Vac, 50Hz, 20A, 10mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC0910	400/415Vac, 50Hz, 10A, 10mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC0916	400/415Vac, 50Hz, 16A, 10mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DD1940	400/415Vac, 50Hz, 40A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DD1963	400/415Vac, 50Hz, 63A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DD1950	400/415Vac, 50Hz, 50A, 30mA, 3+N, Type A, D Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2940	400/415Vac, 50Hz, 40A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2963	400/415Vac, 50Hz, 63A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2950	400/415Vac, 50Hz, 50A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2916	400/415Vac, 50Hz, 16A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2910	400/415Vac, 50Hz, 10A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2932	400/415Vac, 50Hz, 32A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2920	400/415Vac, 50Hz, 20A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC2925	400/415Vac, 50Hz, 25A, 100mA, 3+N, Type A, C Curve
Residual Current Device	RCBO	Schneider Electric	A9DC1910	400/415Vac, 50Hz, 10A, 30mA, 3+N, Type A, C Curve

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate of Conformity remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to [www.jasanz.org/register](http://www.jasanz.org/register) for verification.



Certification Manager




# Certificate of Conformity

RELEVANT TRADEMARK (S)

COMMENTS OR CONDITIONS ON THE CERTIFICATION

2023/11/12 Modification 1  
- Suitable for sale in New Zealand

End of document

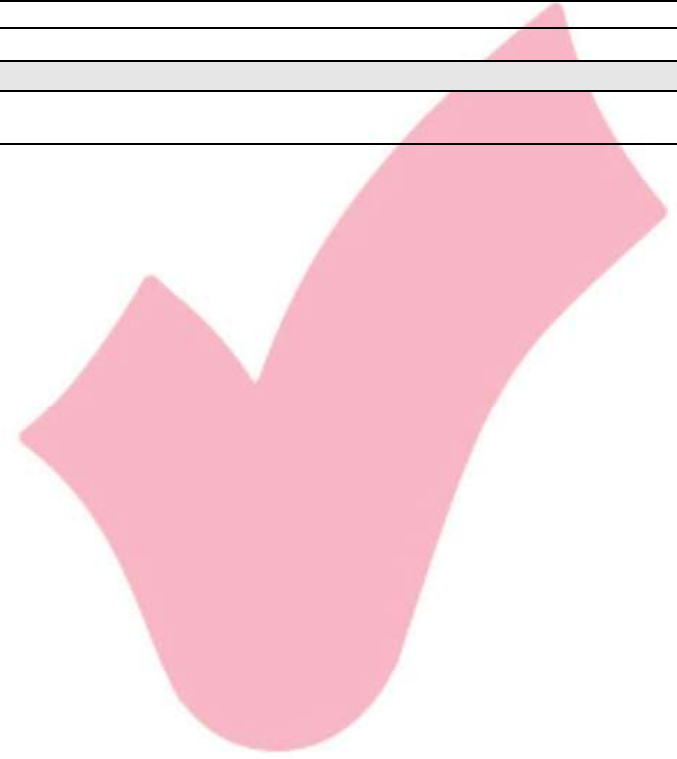

This certification remains valid until the above-mentioned expiry date and subject to the organisation's continued compliance with the certification standard, and Global-Mark's Terms and Conditions. This Certificate of Conformity remains the property of Global-Mark Pty Ltd, Company Number: ACN.108-087-654. The use of the Accreditation Mark indicates accreditation by the Joint Accreditation System of Australia and New Zealand in respect to those activities covered by JAS-ANZ accreditation. Refer to [www.jasanz.org/register](http://www.jasanz.org/register) for verification.



Certification Manager