


GEX26744

PLEASE NOTE

- The installation, maintenance and eventual replacement of this device must only be carried out by a qualified electrician.
- This device must not be repaired.
- All applicable local, regional and national regulations must be complied with during the installation, use, maintenance and replacement of this device.
- This device should not be installed if, when unpacking it, you observe that it is damaged.
- Schneider Electric cannot be held responsible in the event of noncompliance with the instructions in this document and in the documents to which it refers.
- The service instruction must be observed throughout the life time of this device.



Residual current circuit breaker with overcurrent protection (RCBO)
Compliant with AS/NZS 61009.1


⚠⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Turn off all power supplying this product before working on it.
- Use a voltage tester with a suitable rated voltage in order to check that all active conductors aren't energized.
- Carefully inspect the work area to check that no tools or objects could have been left inside the equipment.


Failure to follow these instructions will result in death or serious injury.


1 Description

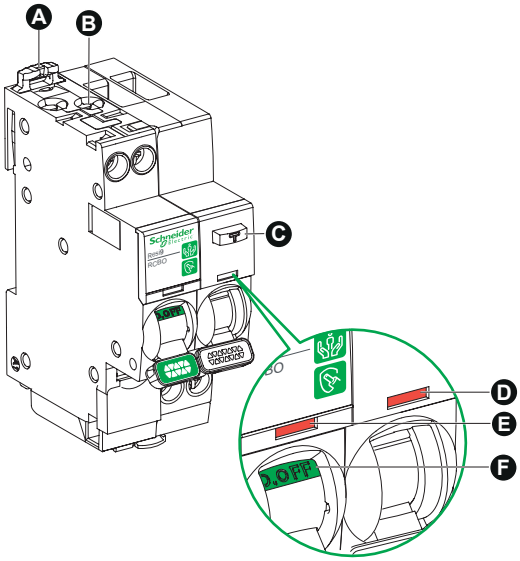


- A Clip for DIN rail mounting
- B Connection terminals
- C Test button
- D VISI-TRIP: Earth leakage fault tripping
- E VISI-TRIP: Short-circuit and overload fault tripping
- F VISI-SAFE: Positive contact indication

2 Installation

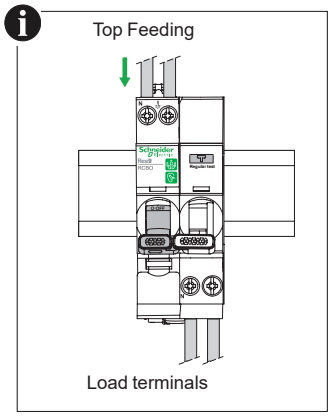







14 mm	1...16 mm²	1...10 mm²
2 N.m	5.5 mm	PZ2

3 Regular test

Note: Test the device at regular intervals by pressing the Test button (marked T), following the intervals defined in your local regulations or monthly.

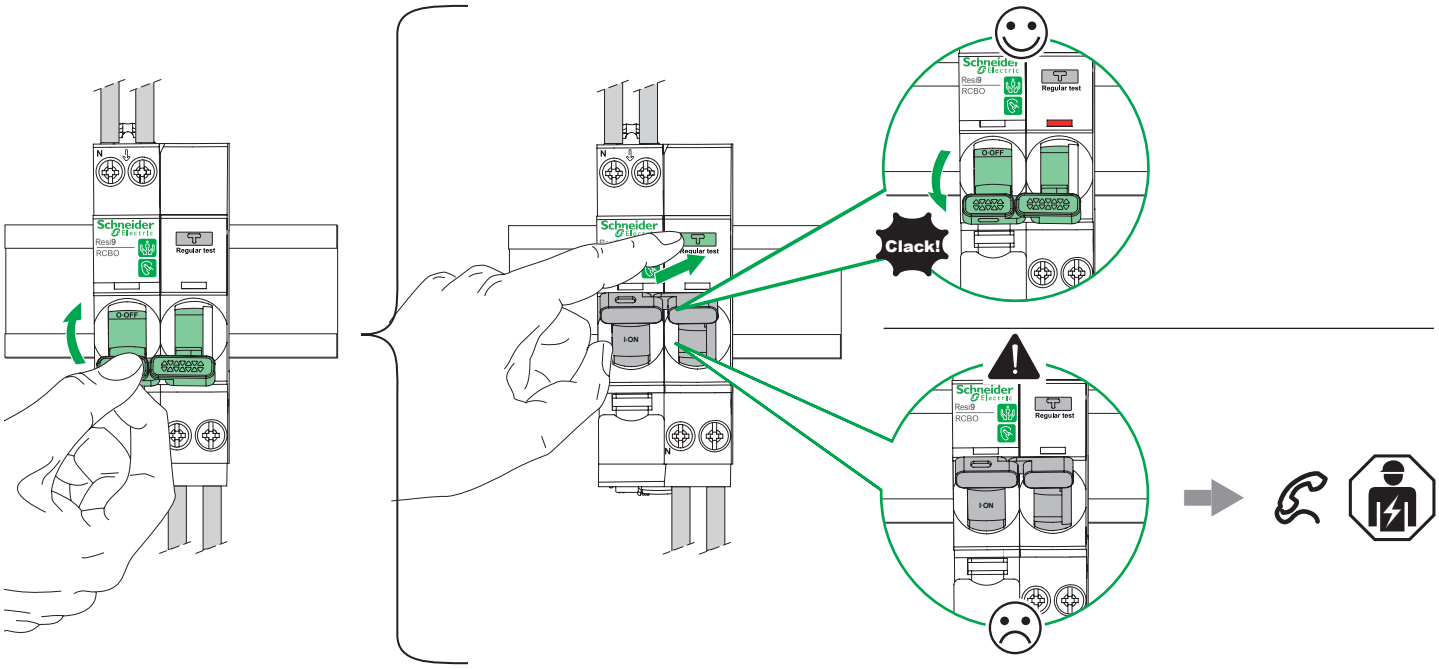

4 More information

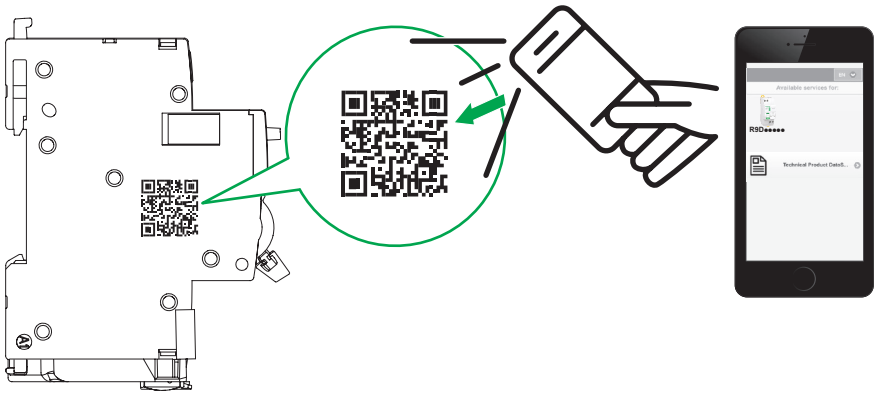

Schneider Electric Industries SAS
35, rue Joseph Monier
CS 30323
F - 92506 Rueil Malmaison Cedex
www.se.com

GEX2674401-00

© 2023 Schneider Electric - All rights reserved.