Draftable Comparison Export

This document is an exported comparison with limited functionality, generated by Draftable Desktop. To access full functionality, use Draftable's powerful comparison viewer in any of our products.

Left document:	ATV_Process_IS_Size6_Kit_IP21-UL_Type1_NHA52502_03.pdf
Right document:	ATV-ATH-IS-Size6-Kit-IP21-UL-Type1-NHA52502-04.pdf

What is this document?

This is a comparison of two documents. The two documents are interleaved such that the left document is displayed on even pages and the right document is displayed on odd pages.

Is there a specific way I should view this file?

This document is intended to be viewed in Two Page Continuous mode (or sometimes called 'Two Page Scrolling'). It should open in this mode by default when using Adobe Acrobat and most popular PDF readers.

If the document opens in a different view, you can often change this in the settings. In Adobe Acrobat, go to **View > Page Display > Two Page Scrolling**

Why are there blank pages?

Blank pages are inserted to keep both documents as aligned as much as possible.

How do I read the changes?

Text deleted from the left document and, hence, not in right document is highlighted red. Text added to the right document and, hence, not in left document is highlighted green.

Tip for printing

When printing this document, we recommend printing double-sided and include this first page. This will result in the matching text being displayed on different pages and easily readable, much like a book.


For more information

Draftable offers powerful document comparison solutions for all use-cases. To view our products, please visit our website: draftable.com.

NHA5250203

Altivar Process Size 6
Kit for IP20 / UL Type 1

VW3A9704

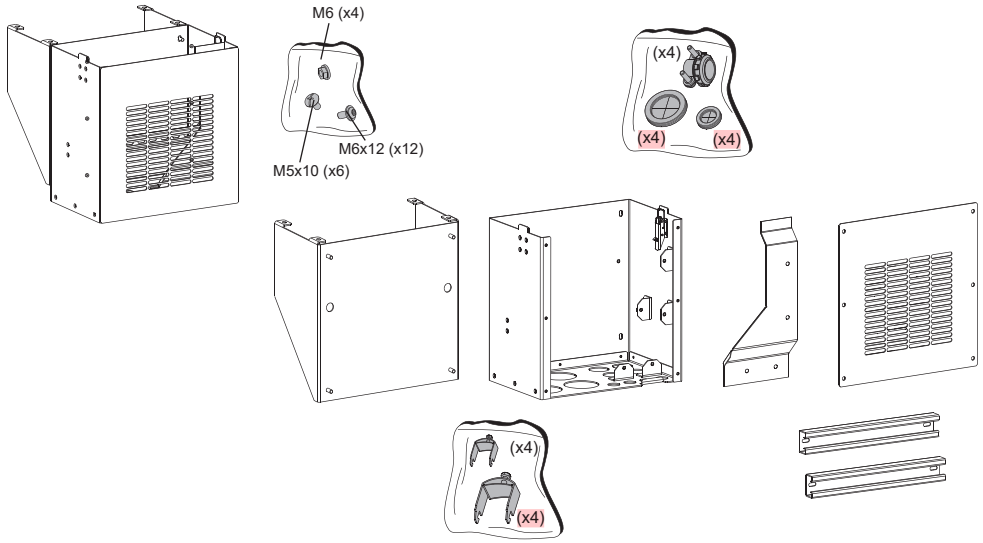

⚠⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Only appropriately trained persons who are familiar with and fully understand the contents of the present manual and all other pertinent product documentation and who have received all necessary training to recognize and avoid hazards involved are authorized to work on and with this equipment.
- Installation, adjustment, repair, and maintenance must be performed by qualified personnel.
- Verify compliance with all local and national electrical code requirements as well as all other applicable regulations with respect to grounding of all equipment.
- Before performing work and/or applying voltage on the equipment, follow the instructions given in the appropriate installation manual.

Failure to follow these instructions will result in death or serious injury.

⚠ CAUTION

SHARP EDGES



Use all necessary personal protective equipment (PPE) such as gloves when performing any type of work whatsoever on or with this product.


Failure to follow these instructions can result in injury or equipment damage.

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel.
No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this product.
© 2024 Schneider Electric. All Rights Reserved.

NHA5250204

Altivar Frame Size 6

Kit for IP20 / UL Type 1 VW3A9704

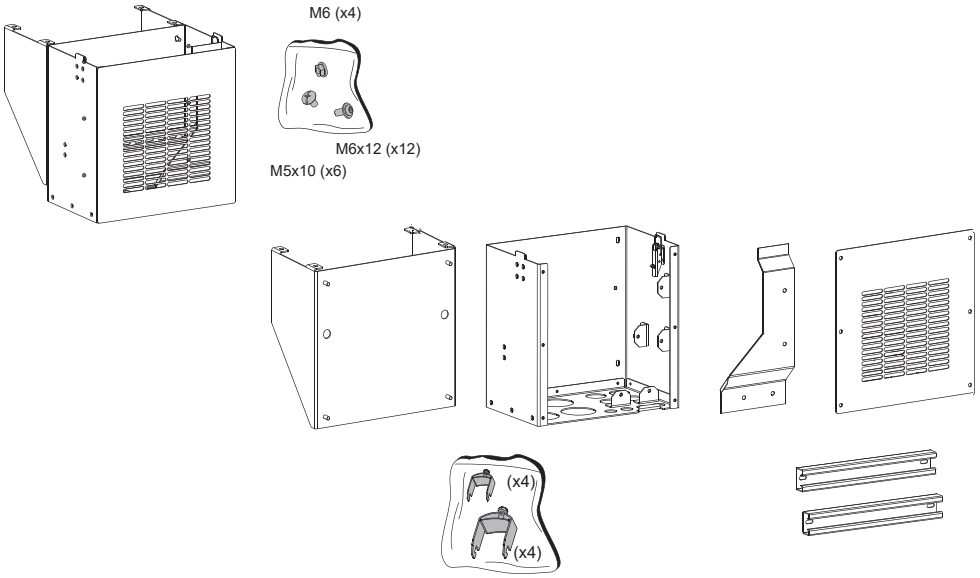

⚠⚠ DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

- Only appropriately trained persons who are familiar with and fully understand the contents of the present manual and all other pertinent product documentation and who have received all necessary training to recognize and avoid hazards involved are authorized to work on and with this equipment.
- Installation, adjustment, repair, and maintenance must be performed by qualified personnel.
- Verify compliance with all local and national electrical code requirements as well as all other applicable regulations with respect to grounding of all equipment.
- Before performing work and/or applying voltage on the equipment, follow the instructions given in the appropriate installation manual.

Failure to follow these instructions will result in death or serious injury.

⚠ CAUTION





SHARP EDGES


Use all necessary personal protective equipment (PPE) such as gloves when performing any type of work whatsoever on or with this product.


Failure to follow these instructions can result in injury or equipment damage.


Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel.
No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this product.
© 2026 Schneider Electric. All Rights Reserved.

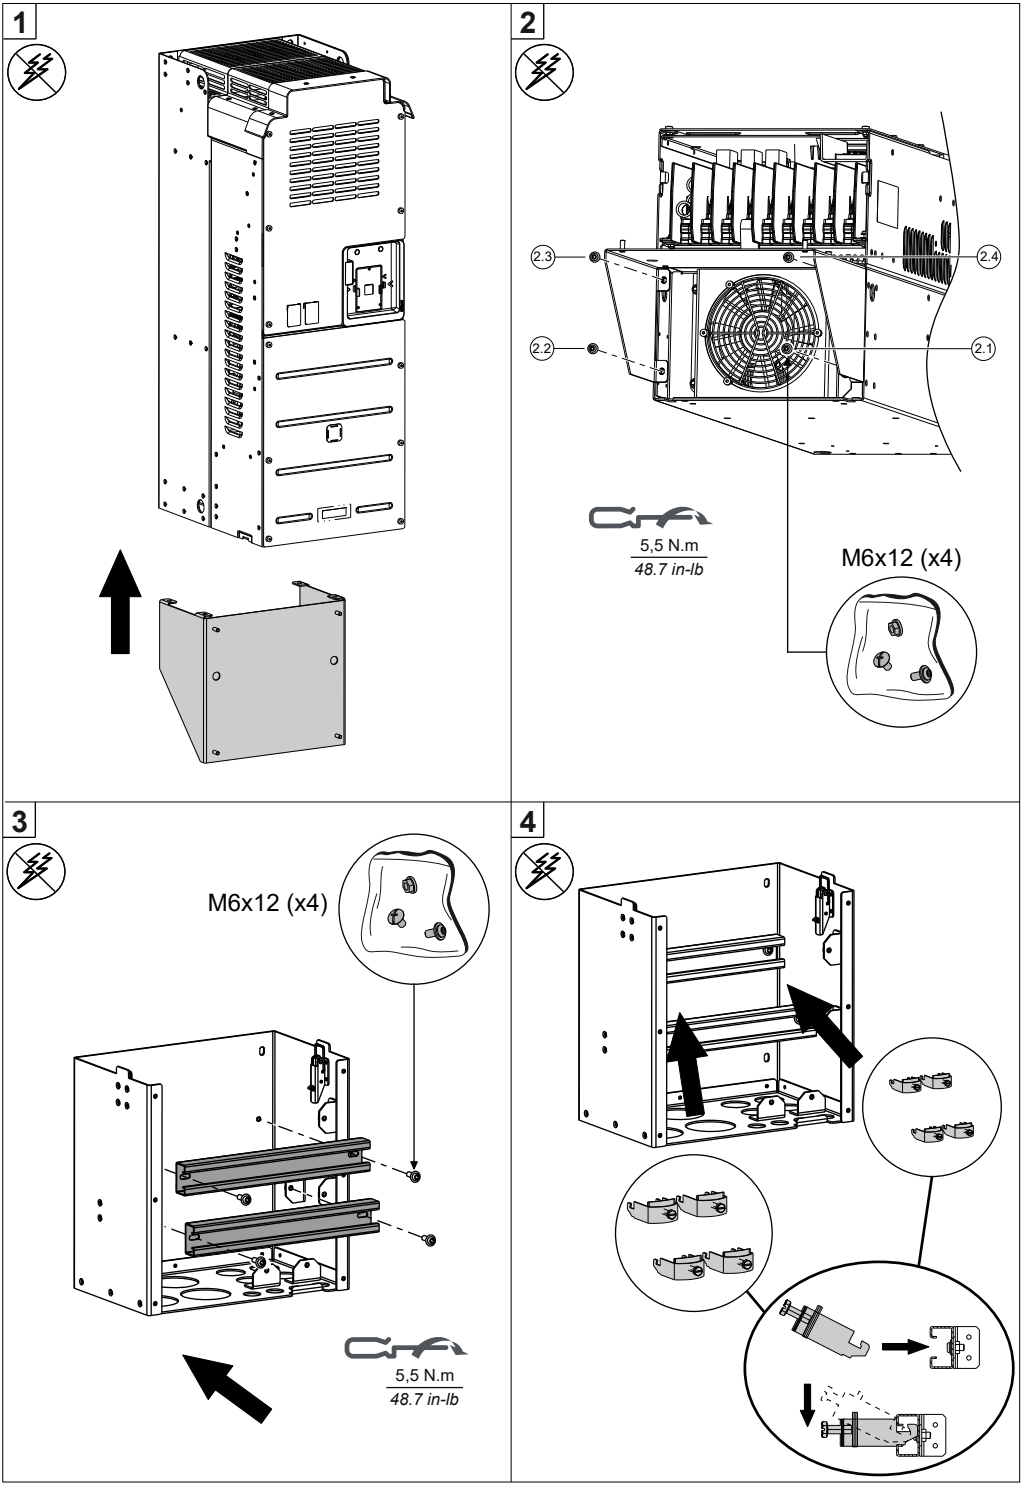

1
2
2.3
2.4
2.2
2.1
5,5 N.m
48.7 in-lb
M6x12 (x4)
3
M6x12 (x4)
5,5 N.m
48.7 in-lb
4

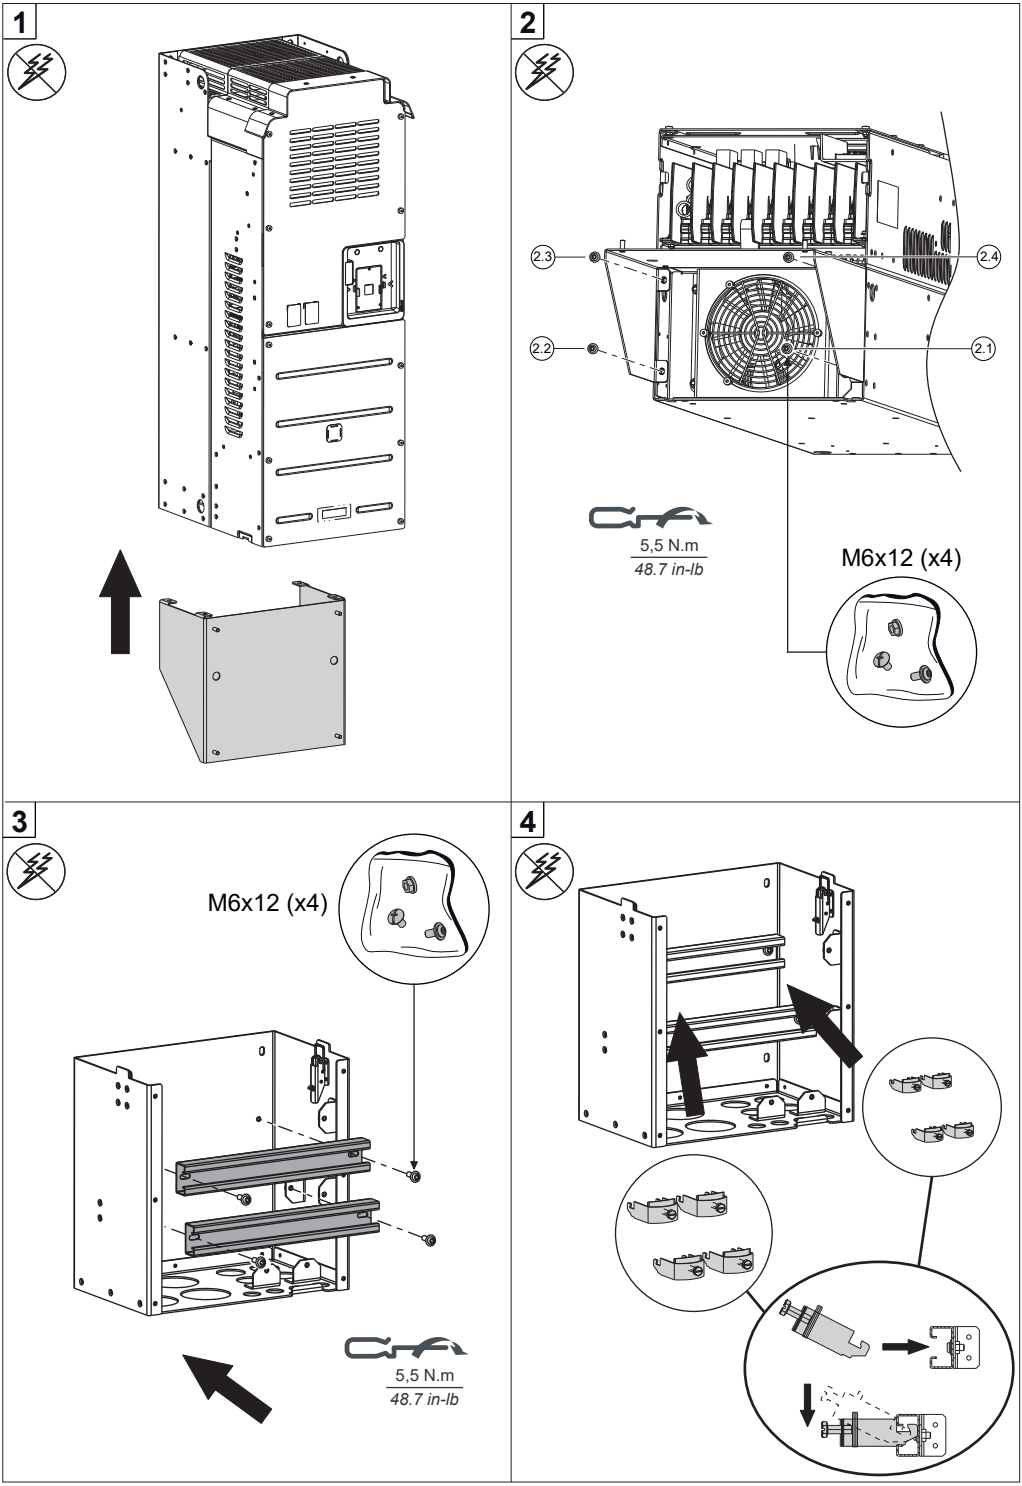

1
2
2.3
2.4
2.2
2.1
5,5 N.m
48.7 in-lb
M6x12 (x4)
3
M6x12 (x4)
5,5 N.m
48.7 in-lb
4

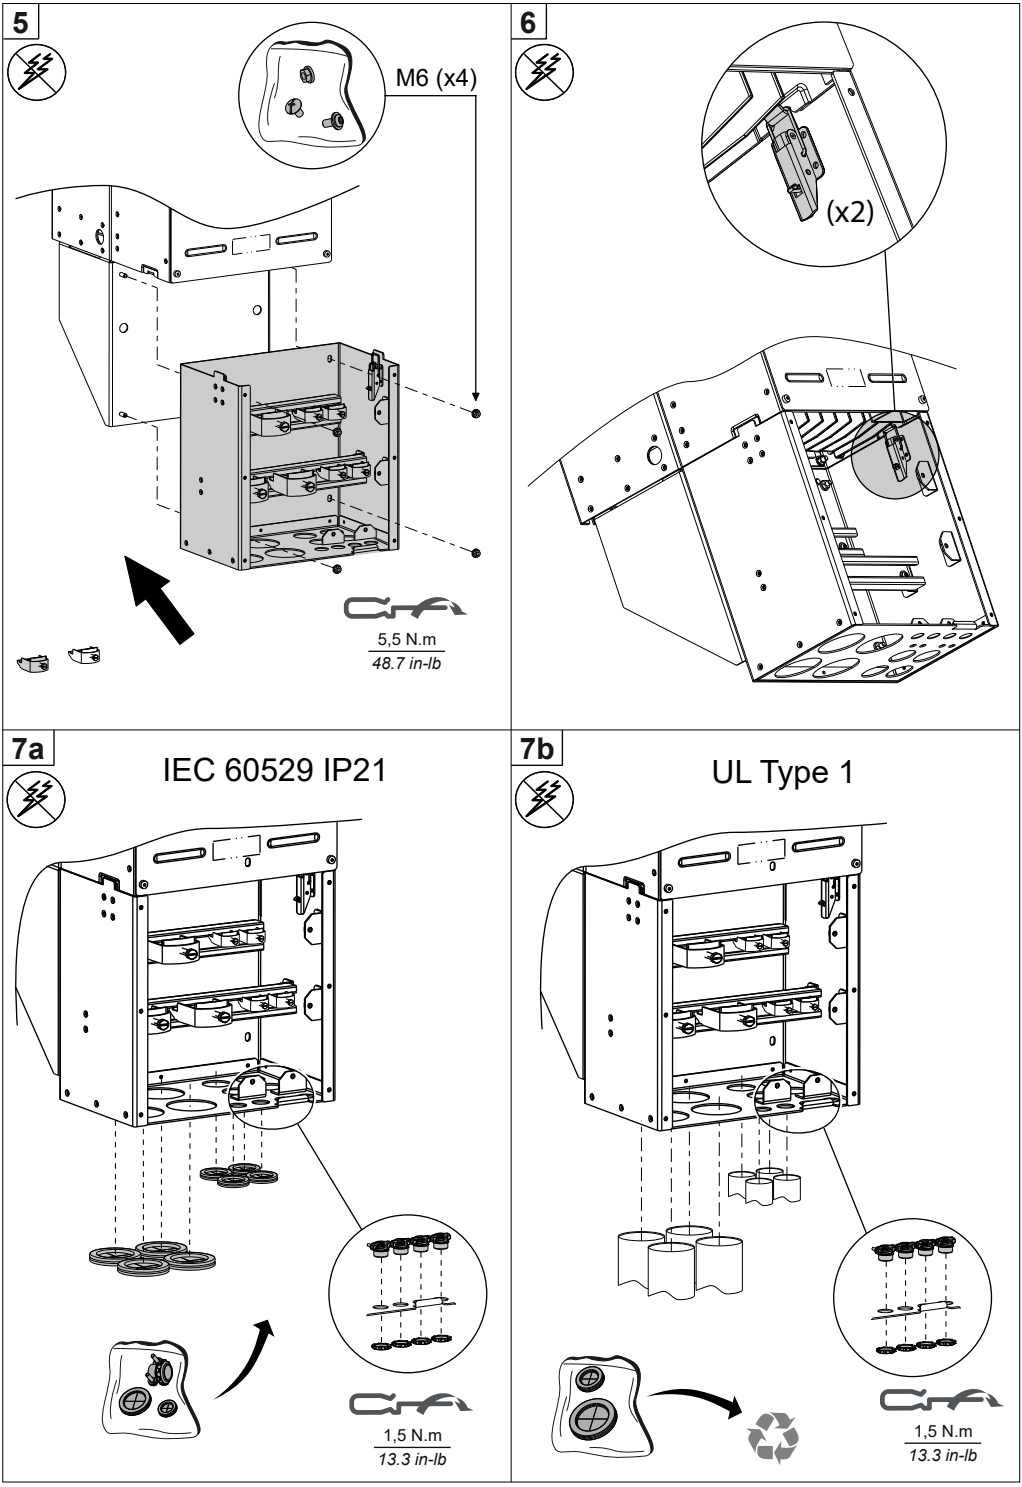
5
M6 (x4)
5,5 N.m
48.7 in-lb
6
(x2)
7a
IEC 60529 IP21
1,5 N.m
13.3 in-lb
7b
UL Type 1
1,5 N.m
13.3 in-lb

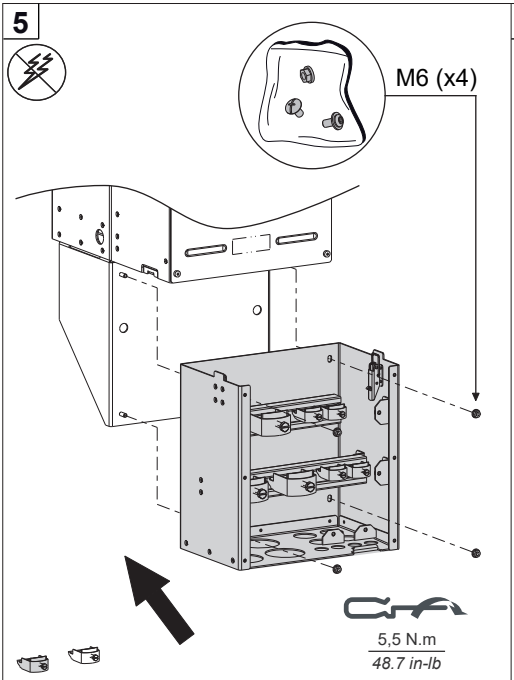

5
M6 (x4)
5,5 N.m
48.7 in-lb

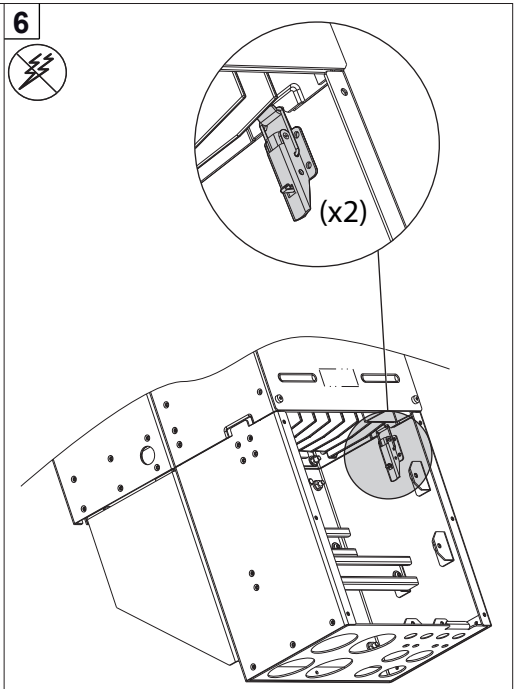
6
(x2)

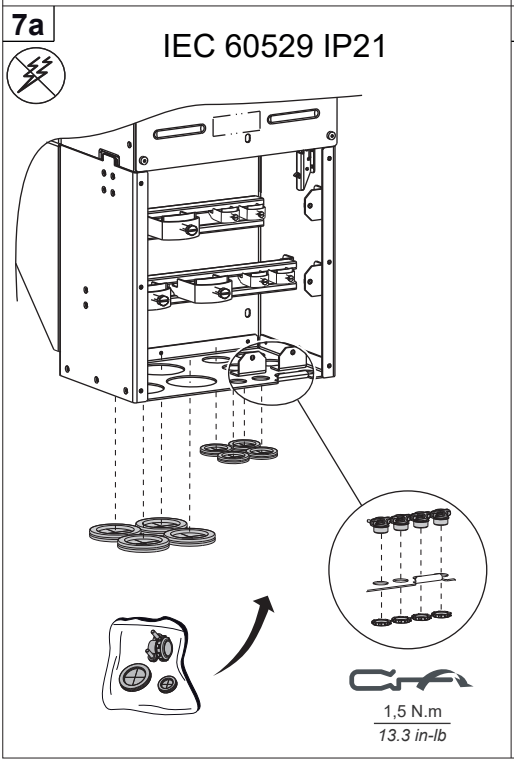

7a
IEC 60529 IP21
1,5 N.m
13.3 in-lb

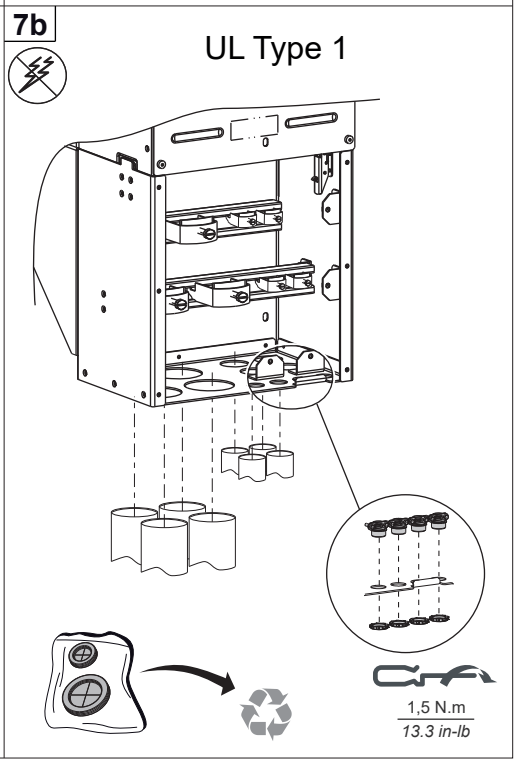
7b
UL Type 1
1,5 N.m
13.3 in-lb

8

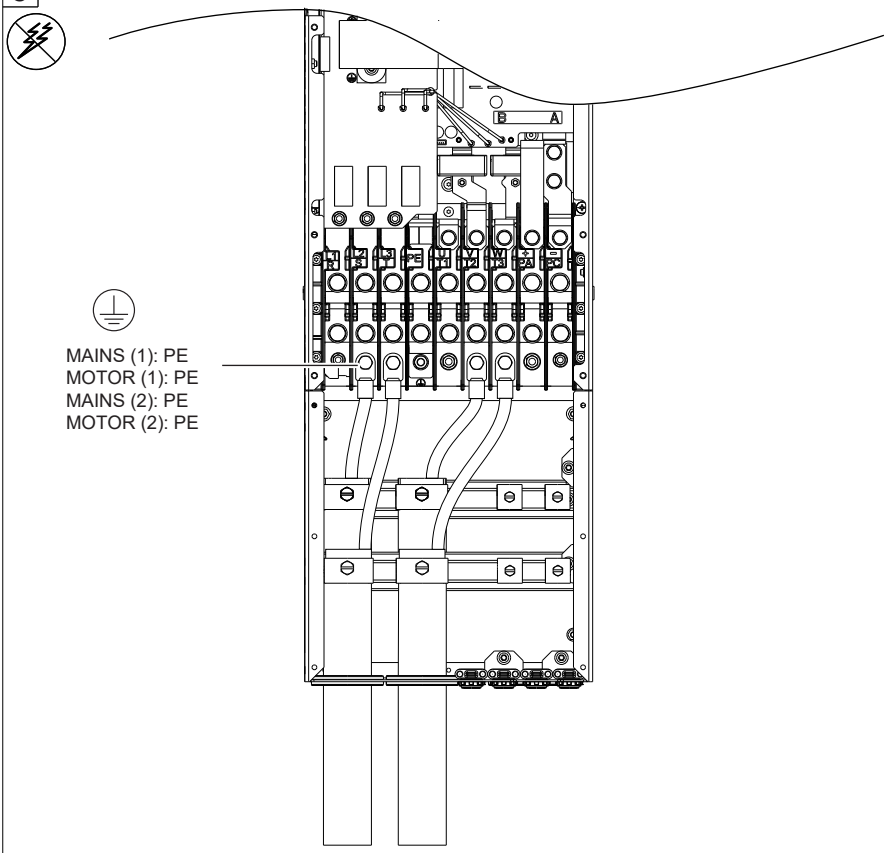


MAINS (1): PE
MOTOR (1): PE
MAINS (2): PE
MOTOR (2): PE

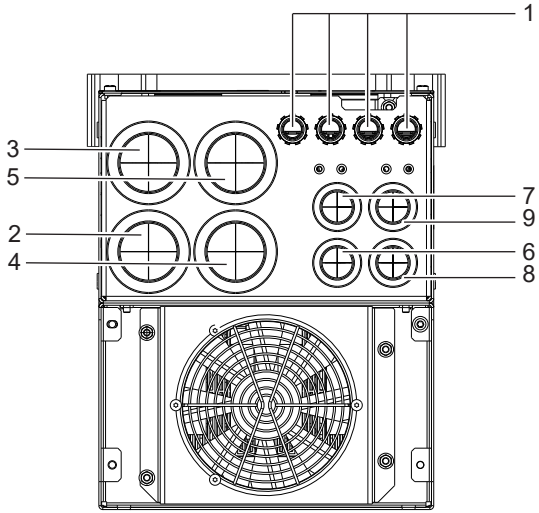


1 - CONTROL CABLES
2 - MAINS (1): R/L1, S/L2, T/L3
3 - MAINS (2): R/L1, S/L2, T/L3
4 - MOTOR (1): U/T1, V/T2, W/T3
5 - MOTOR (2): U/T1, V/T2, W/T3
6 - PA/+ (1)
7 - PA/+ (2)
8 - PC/- (1)
9 - PC/- (2)

8

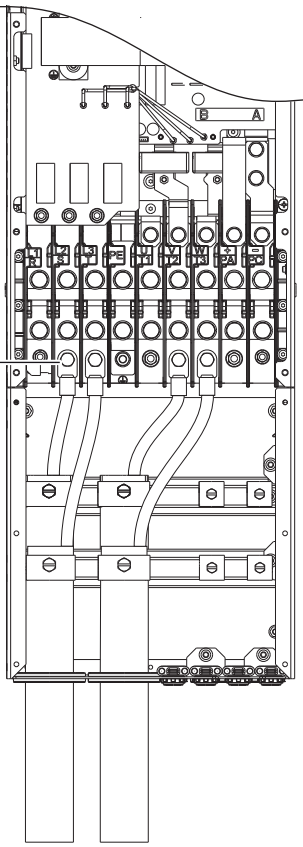


MAINS (1): PE
MOTOR (1): PE
MAINS (2): PE
MOTOR (2): PE

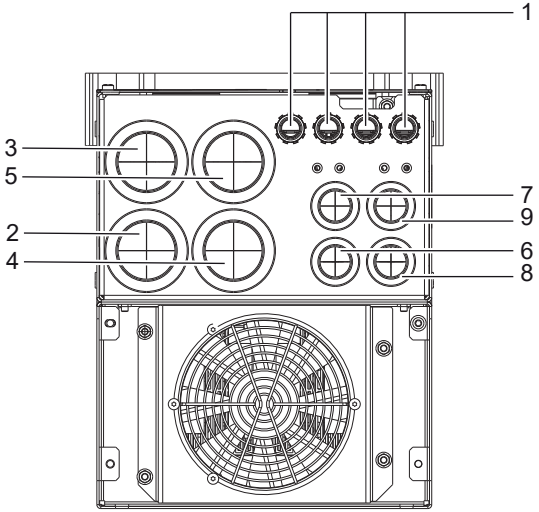


1 - CONTROL CABLES
2 - MAINS (1): R/L1, S/L2, T/L3
3 - MAINS (2): R/L1, S/L2, T/L3
4 - MOTOR (1): U/T1, V/T2, W/T3
5 - MOTOR (2): U/T1, V/T2, W/T3
6 - PA/+ (1)
7 - PA/+ (2)
8 - PC/- (1)
9 - PC/- (2)

9

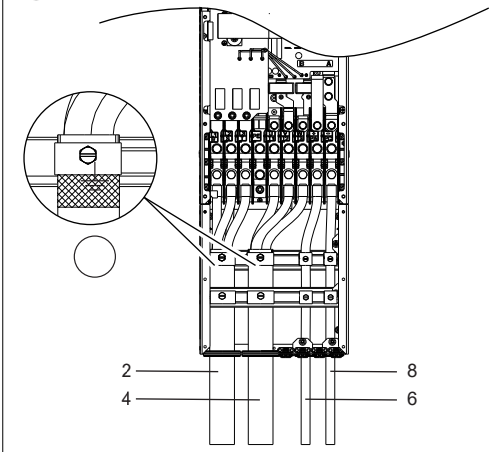


2 - MAINS (1): R/L1, S/L2, T/L3
4 - MOTOR (1): U/T1, V/T2, W/T3
8 - PC/- (1)
6 - PA/+ (1)

10

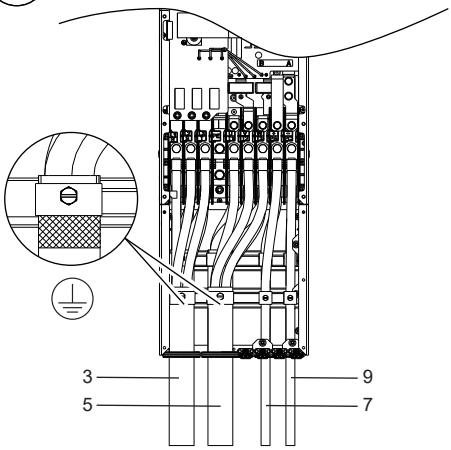


3 - MAINS (2): R/L1, S/L2, T/L3
5 - MOTOR (2): U/T1, V/T2, W/T3
9 - PC/- (2)
7 - PA/+ (2)


11

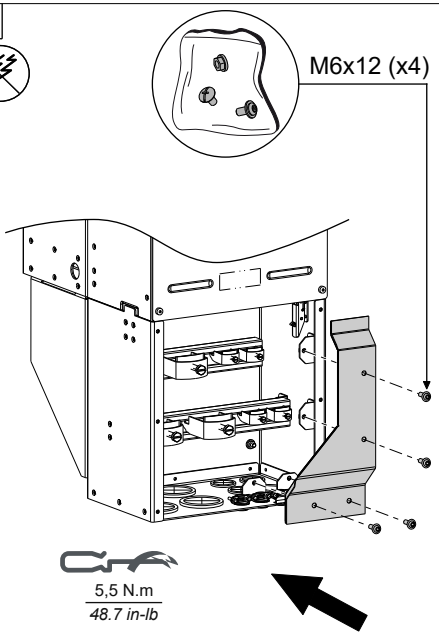

12

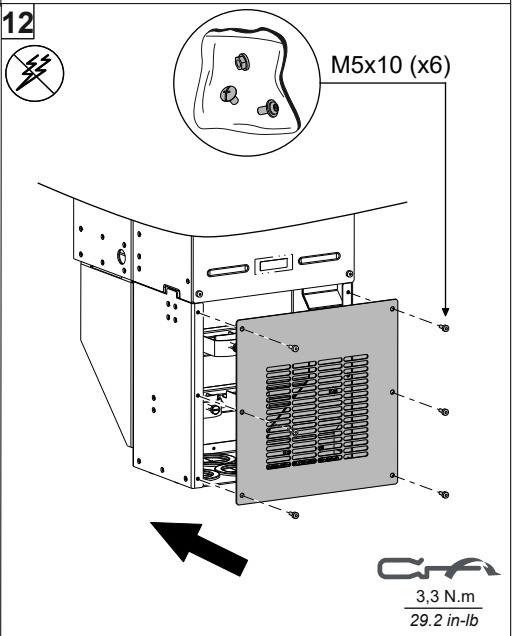


9

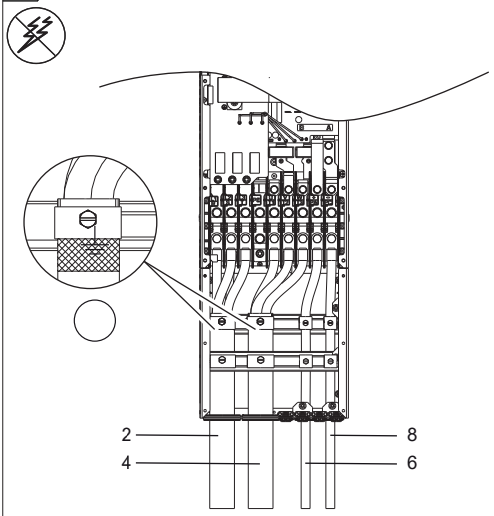


2 - MAINS (1): R/L1, S/L2, T/L3
4 - MOTOR (1): U/T1, V/T2, W/T3
8 - PC/- (1)
6 - PA/+ (1)

10

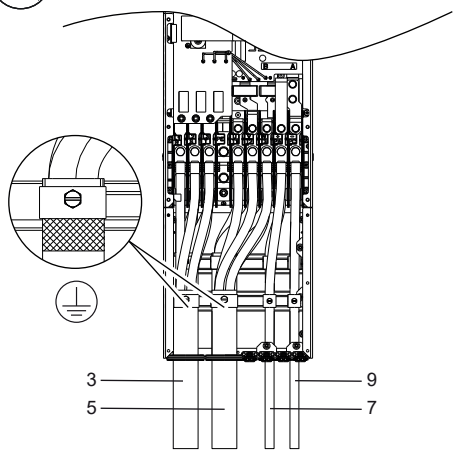



3 - MAINS (2): R/L1, S/L2, T/L3
5 - MOTOR (2): U/T1, V/T2, W/T3
9 - PC/- (2)
7 - PA/+ (2)

11

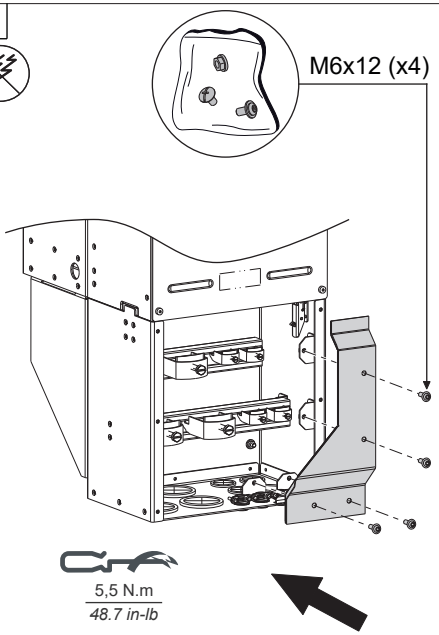

12

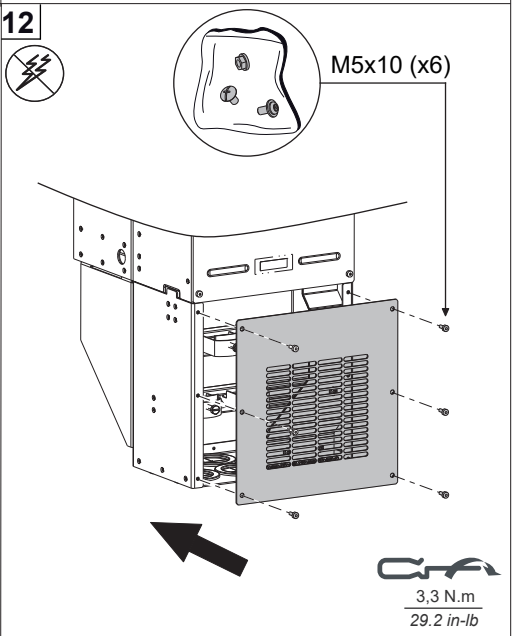

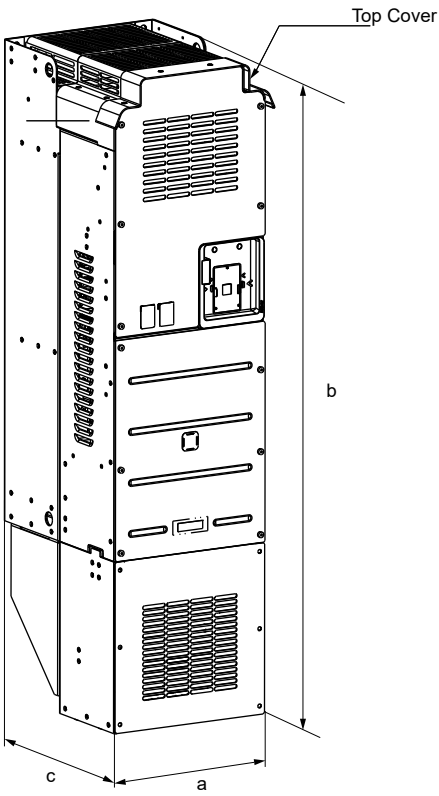


	a		b		c	
	mm	in.	mm	in.	mm	in.
IP21 (with Top Cover)	320	12.60	1159.80	45.66	390	15.35
IP20 (without Top Cover)	300	11.80	1157.80	45.58	380	14.96

MANUFACTURER
Schneider Electric Industries SAS
35 rue Joseph Monier
Rueil Malmaison 92500 France

UK REPRESENTATIVE
Schneider Electric Limited
Stafford Park 5
Telford, TF3 3BL United Kingdom

Опция для продуктов Altivar и Altistart. Пожалуйста, обратитесь к сообщению о преобразователе частоты EAC / программном сартере в приложении к началу работы,размещенном на веб-сайте производителя.
Авторизованный поставщик в Республике Казахстан:
ТОО «Шнейдер Электрик»
Адрес: 050010, РК, г. Алматы, пр. Достык, 38, бизнес-центр «Кен Дала», 5 этаж, левое крыло.
Тел.: +7 (727) 339 23 57
Номер службы поддержки клиентов:
Тел.: +7 (727) 339 24 52

Altivar және Altistart өніміне арналған опция.
Өндірушінің веб-сайтында орналастырылған «Жұмысқа кірісу» қосымшасындағы EAC жиілік инвертер / бірқалыпты іске қосу құрылғысы хабарламасына сілтеме жасауыңызды сұраймыз.
Қазақстан Республикасындағы уәкілетті жеткізуші:
ЖШС «Шнейдер Электрик»
Мекен-жайы: 050010, ҚР, Алматы қаласы, Достық даңғылы, 38, «Кең дала» бизнес орталығы, 5-қабат, сол қанат.
тел.: +7 (727) 339 23 57
Клиенттерге қызмет көрсету нөмірі:
тел.: +7 (727) 339 24 52

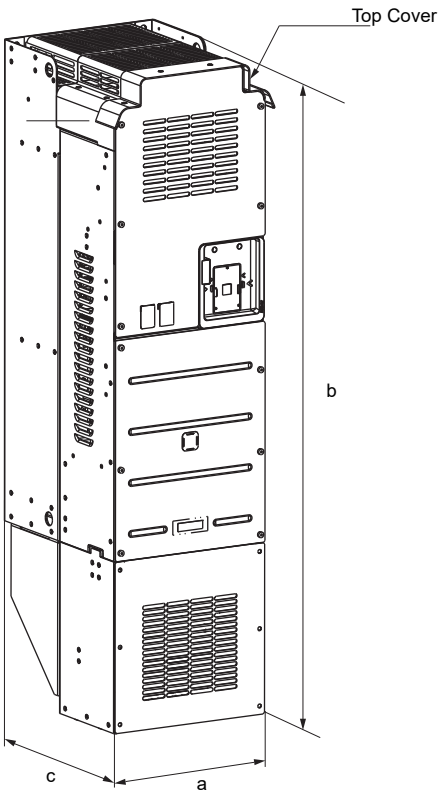

	a		b		c	
	mm	in.	mm	in.	mm	in.
IP21 (with Top Cover)	320	12.60	1160	45.66	390	15.35
IP20 (without Top Cover)	300	11.80	1158	45.59	380	14.96

MANUFACTURER
Schneider Electric Industries SAS
1884 Boulevard de la Défense
92000 Nanterre France

UK REPRESENTATIVE
Schneider Electric Limited
Stafford Park 5
Telford, TF3 3BL United Kingdom

Опция для продуктов Altivar и Altistart. Пожалуйста, обратитесь к сообщению о преобразователе частоты EAC / программном сартере в приложении к началу работы,размещенном на веб-сайте производителя.
Авторизованный поставщик в Республике Казахстан:
ТОО «Шнейдер Электрик»
Адрес: 050010, РК, г. Алматы, пр. Достык, 38, бизнес-центр «Кен Дала», 5 этаж, левое крыло.
Тел.: +7 (727) 339 23 57
Номер службы поддержки клиентов:
Тел.: +7 (727) 339 24 52

Altivar және Altistart өніміне арналған опция. Өндірушінің веб-сайтында орналастырылған «Жұмысқа кірісу» қосымшасындағы EAC жиілік инвертер / бірқалыпты іске қосу құрылғысы хабарламасына сілтеме жасауыңызды сұраймыз.
Қазақстан Республикасындағы уәкілетті жеткізуші:
ЖШС «Шнейдер Электрик»
Мекен-жайы: 050010, ҚР, Алматы қаласы, Достық даңғылы, 38, «Кең дала» бизнес орталығы, 5-қабат, сол қанат.
тел.: +7 (727) 339 23 57
Клиенттерге қызмет көрсету нөмірі:
тел.: +7 (727) 339 24 52